

# HYGROTHERMAL SNAPSHOT

## Resilient All-Wood R-30 Wall



Minneapolis, Minnesota | 44.52°N 66.00°W | Elev. 872 ft | -6 UTC

**RATING**


Pass



ASSEMBLY COMPONENTS			PARAMETERS		CLIMATE NORMALS	
1	Cedar Siding	0.375 in	Test Duration	2 Yrs	Temp. Daily Max / Min	53.9°F / 35.9°F
2	Rainscreen Air Space	0.75 in	Interior Moisture	Low	RH Daily Max / Min	79% / 59%
3	Housewrap WRB	0.008 in	Interior Temperature	69.8°F ± 1.8°F	Rainfall	30.6 in
4	Fiberboard Insulation	3 in	Interior Humidity	45% ± 15%	Snowfall	54.4 in
5	Fiberboard Sheathing	0.492 in	Orientation / Inclination	N / 90°	Wind Speed	9.7 mph
6	Wood Shavings	5.5 in	Exterior Coating	-	Wind Direction	320°
7	Intello Smart VR	0.008 in	Interior Coating	-	Station Air Pressure	29.1 in
8	Interior Gypsum Board	0.492 in	Rain Exposure / Deposition <sup>1</sup>	1 / 0.5	Heating Degree Days (65 F)	7,580
9	Interior Paint & Primer	0.003 in	Rain Penetration <sup>1</sup> (▶)	1%, 0.5%	Cooling Degree Days (65 F)	753
			Rainscreen / ACH	Yes / 60	Modeled Climate Data	WUFI

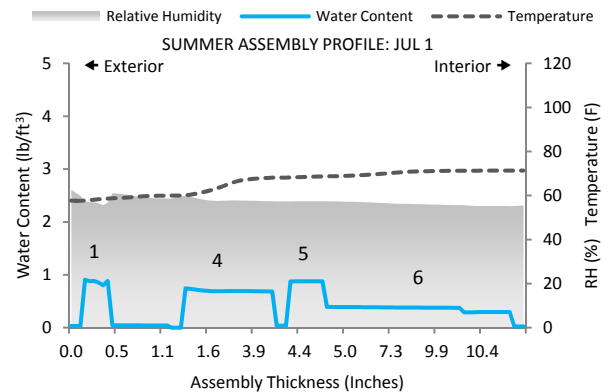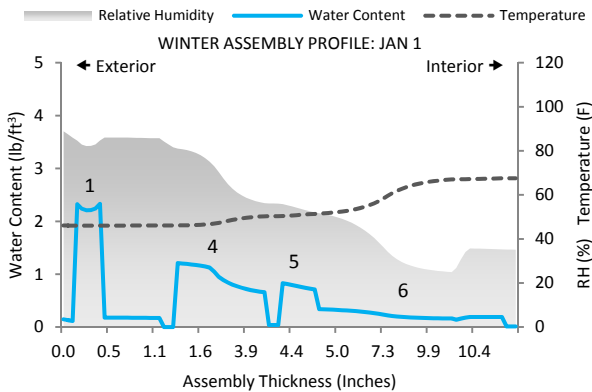

### MOLD AND CORROSION RISKS AT PREDICTED RH AND SURFACE TEMPERATURES (YEAR 2)

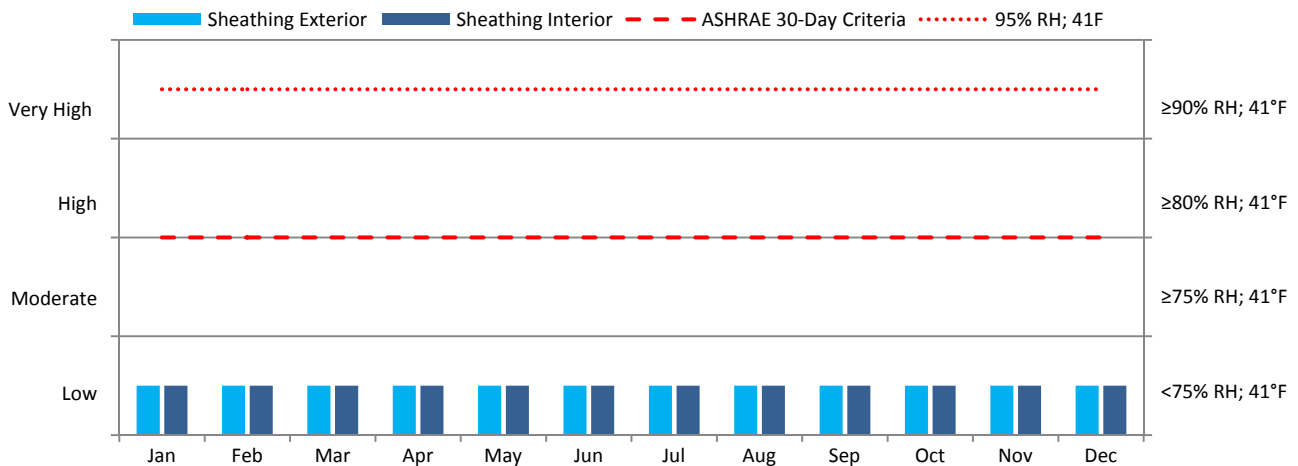

#### PERFORMANCE RATINGS

Ratings are based on ASHRAE Standard 160<sup>1</sup>. Resistant materials are evaluated based on hourly 30-day running averages at ≥95% RH, 41°F.

P = Pass; Criteria met

C = Conditional; Criteria compliance is uncertain

F = Fail; Criteria not met for a 30-day running average

CF = Critical Fail; Criteria not met at multiple 30-day running averages

1. ASHRAE Standard 160: Criteria for Moisture-Control Design Analysis in Buildings.

#### ABOUT THIS REPORT

These findings are offered for informational purposes only and are not intended as a comprehensive hygrothermal analysis. Design considerations should not rely on this report as the sole means for predicting assembly performance. Uncertainties and limitations inherent to hygrothermal modeling apply to these findings<sup>2</sup>. For more information, visit our website at [www.built-environments.com](http://www.built-environments.com).

2. ASTM MNL 18: Moisture Control in Buildings.